


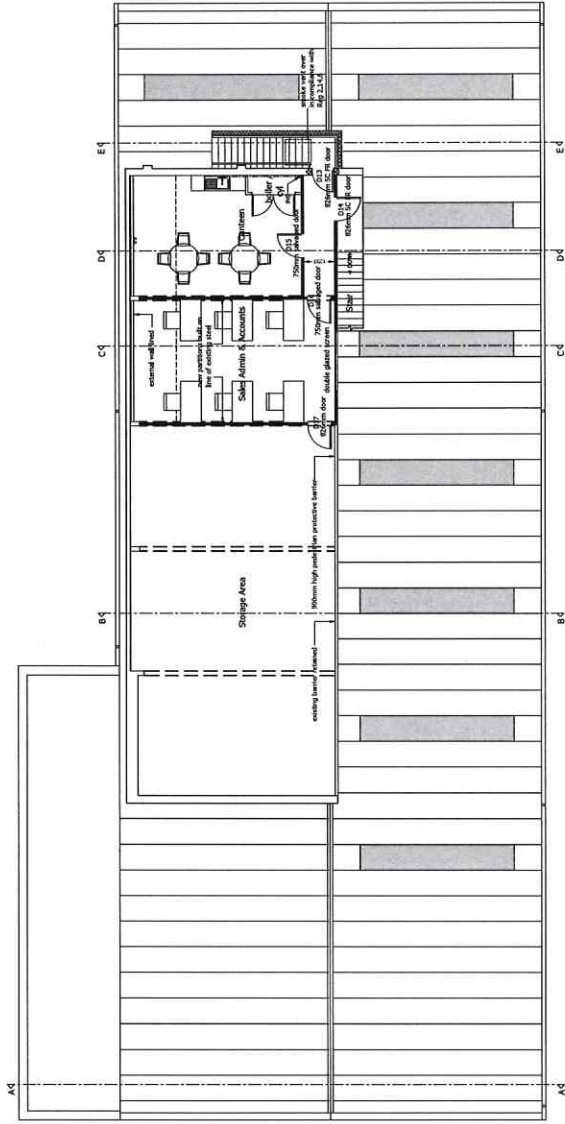

MEZZANINE / ROOF PLAN

Automatic fire detection and alarm system to BS 5839 Part 1, 2002 to Category L1.


Showroom and office lighting to comply with NISAN CI requirements.

Electrical installations to be installed in accordance with BS 5266 and comprise:


- The emergency lighting to be installed in accordance with BS 5266 and comprise:
- The general lighting installations to be installed in accordance with 6.5.4 of the Building Standards (Scotland) Regulations 2007

Mechanical ventilation to be provided to the showroom offices, sales admin and accounts offices and to the workshop in compliance with guidance in BS 5201-2:2001 or equivalent with the following:


- Customer and workshop offices to be mechanically ventilated in compliance with the table to BS 5201-2:2001
- Non-mechanical ventilation to offices and customer:
- 1 layer 12.0mm plasterboard each side of 70mm Gyproc® C studs at 600mm centres with sound insulation in cavity

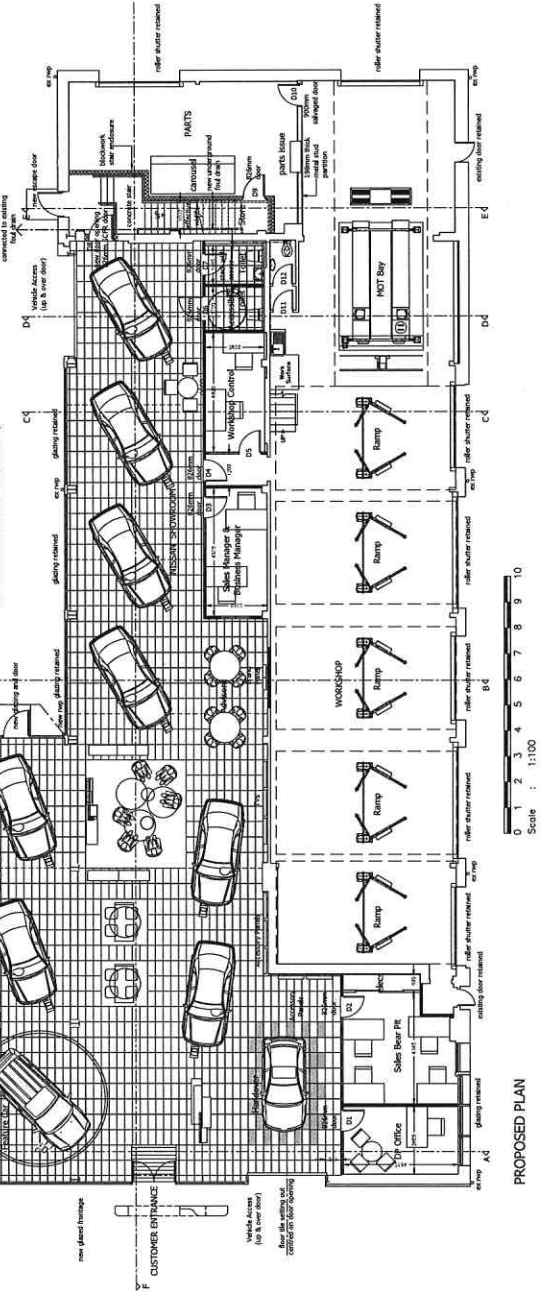


PROPOSED PLAN

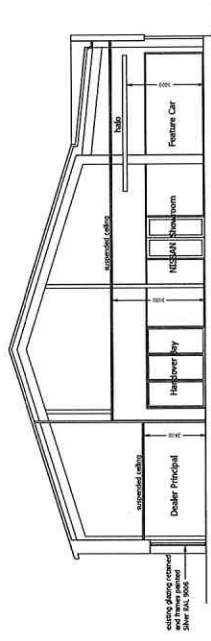


SECTION A-A

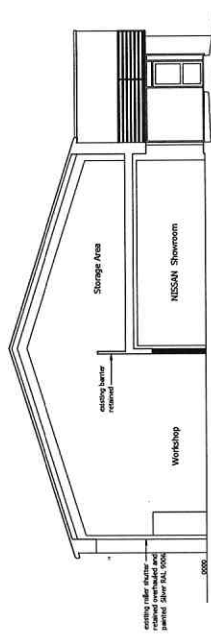


SECTION B-B

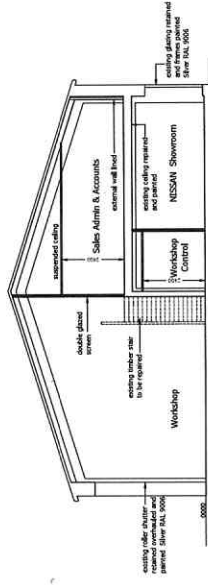

SECTION C-C

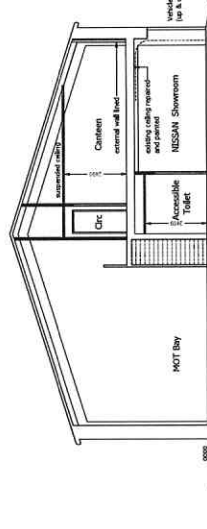

SECTION D-D

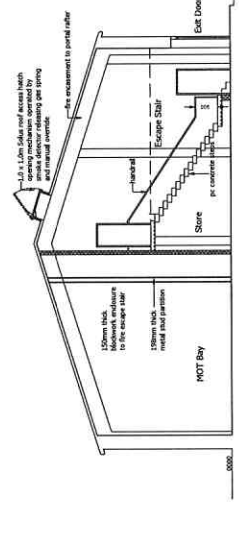

SECTION E-E